


# ETO2

## ETO2 wiring diagram, with extern output relay panel

For applications with heating cable of more than 16Amps.

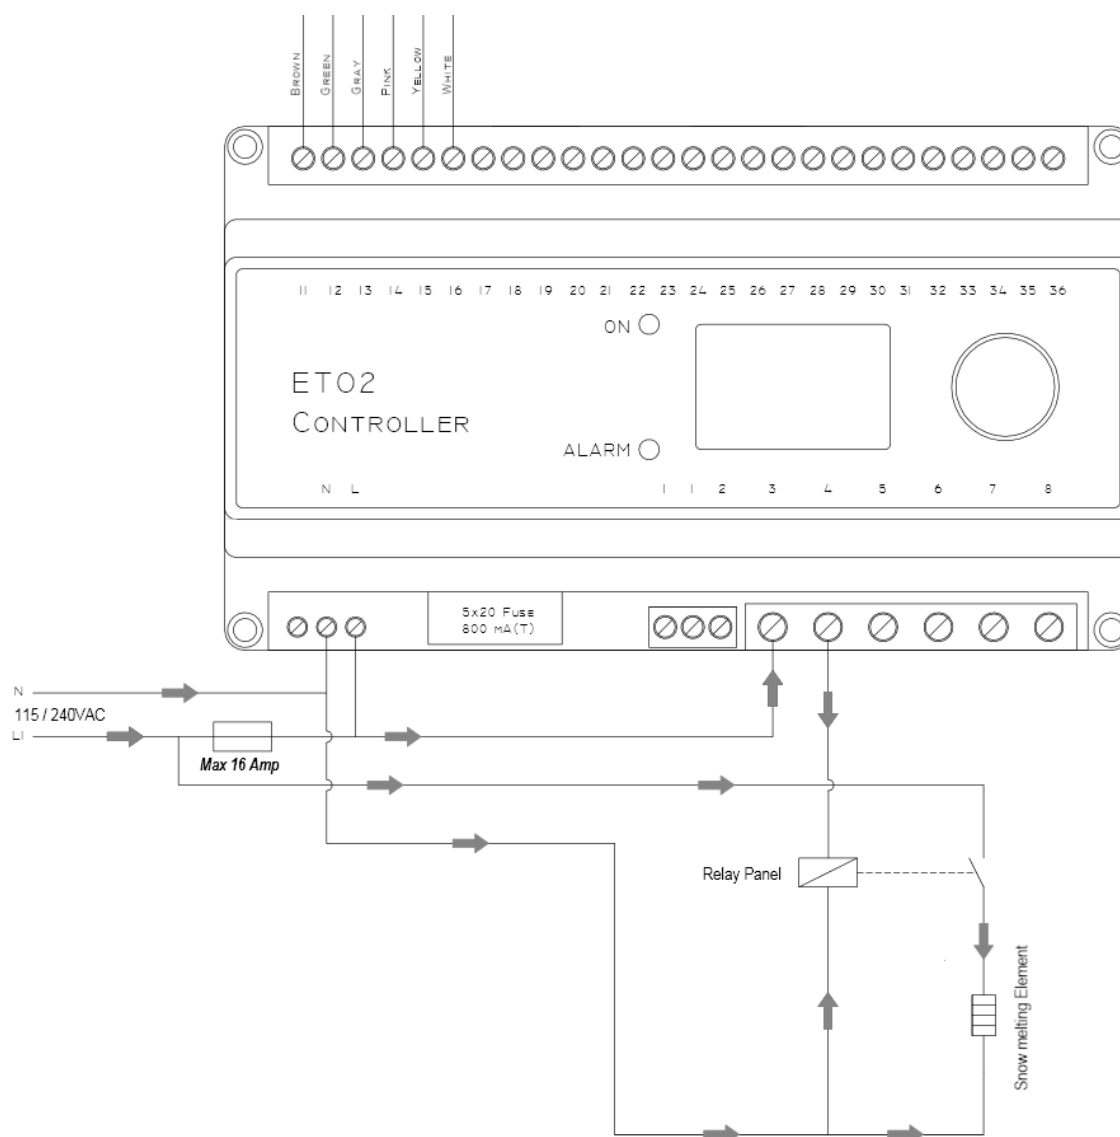

### ETO2 installation with extern relay panel

- 1) Connect supply 115-240VAC to terminals N and L.  
 ⚠ **Note:** Max fuse 16A for the ETO2.
- 2) Connect the coil of the Relay Panel to the ETO2 output relay 1, terminal 3 and 4.  
**Note:** ETO2 output relays are potential-free contacts, NO, "Normal open"  
 Potential-free contact means that the relay contact will be free of voltage. You need to supply your own signal voltage. The voltage that is present is whatever you supply. (This example is with 115-240VAC supply)
- 3) Connect the heating cable to the contacts of the Relay Panel.

⚠ **WARNING** This control unit and associated components should only be installed by a competent person (i.e. a qualified electrician). Electrical installation must be in accordance with appropriate statutory regulations.

©Copyright 2013 by OJ ELECTRONICS A/S. All rights reserved. OJ ELECTRONICS A/S reserves the right to make any changes without prior notice

OJ ELECTRONICS A/S  
 STENAGER 13B  
 DK-6400 SØNDERBORG  
 DENMARK

T. +45 73 12 13 14  
 F. +45 73 12 13 13  
 OJ@OJ.DK  
 WWW.OJ.DK

  
**OJ ELECTRONICS**  
*taking comfort further*